


CSU SAN BERNARDINO

2025 ANNUAL FIRE SAFETY REPORT

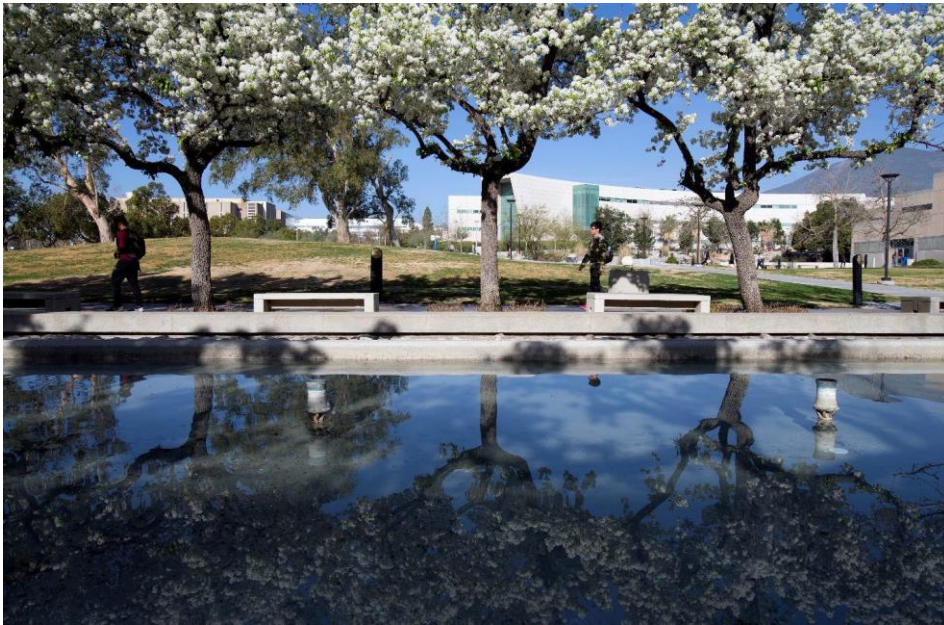

SAN BERNARDINO CAMPUS

JEANNE CLERY DISCLOSURE OF CAMPUS SECURITY POLICIES & CAMPUS CRIME STATISTICS ACT
(20 U.S.C. § 1092(F))

A description of the fire safety system for each on-campus student housing facility:

- **6000 University Parkway - Arrowhead Village - Bldg. 2, 3, 4, 5, 6:** Simplex Fire Alarm System with two independent systems monitored by the University Police Department (UPD) via Simplex 4100 panels. It has battery backup along with addressable devices (smoke detectors, pull stations) horns, strobes located in hallways, mechanical rooms, stairwells, and select ADA rooms. There are fire sprinklers throughout all Arrowhead Village buildings in all spaces/rooms with flow switches connected to the Simplex panels.
- **6000 University Parkway – Cajon, Coyote Village, Running Springs:** Simplex Fire Alarm System with three independent systems monitored by UPD via Simplex 4100ES panels. It has battery backup along with addressable devices (smoke detectors, pull stations) horns, strobes located in hallways, mechanical rooms, stairwells, and select ADA rooms. There are fire sprinklers throughout all buildings in all spaces/rooms with flow switches connected to the Simplex panels.
- **6000 University Parkway – Badger, Joshua, Mojave, Morongo, San Manuel, Serrano, Shandin, Tokay, Waterman:** Simplex Fire Alarm System with two independent systems monitored by UPD via Simplex 4100 U panels. It also has battery backup along with addressable devices (smoke detectors, pull stations) horns, strobes and fire smoke dampers located in hallways, mechanical rooms, stairwells and common areas, but not inside of bedrooms. *No fire sprinkler system in these halls.
- **1577 Northpark Blvd. - University Village – Bldg. 7, 8, 9:** Secutron Fire Alarm System with one "Main" MR 2200 Secutron panel monitoring all three buildings to include the main office (clubhouse) and reporting to UPD. It also has battery backup along with addressable devices (smoke detectors, pull stations) horns, strobes and fire smoke dampers located in hallways, mechanical rooms, stairwells and common areas. There is a fire sprinkler system throughout all the buildings and spaces/rooms with flow switches connected to the Secutron Fire Panel.
- **In the event of a sustained power or alarm system failure, the campus's Fire Watch Policy is implemented.**

The number of fire drills held the previous calendar year:

| On-Campus Student Housing Facilities | Number of fire drills |
|--|--|
| 6000 University Parkway - Arrowhead Village - Bldg. 2, 3, 4 | 1 Fall Semester / 1 Spring Semester |
| 6000 University Parkway - Arrowhead Village - Bldg. 5, 6 | 1 Fall Semester / 1 Spring Semester |
| 6000 University Parkway – Coyote Village - Cajon Hall and Running Springs | 1 Fall Semester / 1 Spring Semester |
| 6000 University Parkway – Badger, Joshua, Mojave, Morongo, San Manuel, Serrano, Shandin, Tokay, Waterman | 0; buildings are closed and unoccupied |
| 1577 Northpark Blvd. - University Village – Bldg. 7, 8 | 1 Fall Semester / 1 Spring Semester |
| 1577 Northpark Blvd. - University Village – Bldg. 9 | 1 Fall Semester / 1 Spring Semester |

The institution's policies or rules on portable electrical appliances, smoking, and open flames in student housing facilities:

- **Combustibles** - Possessing or storing gasoline, fireworks, combustible chemicals and/or fuel-driven engines/appliances (e.g., motorcycles, mopeds, gas/propane grills, etc.) within residential housing apartments, rooms, balconies, buildings and/or on grounds immediately adjacent to the on-campus housing facilities is prohibited.
- **Open Flames (Candles)** - Candles, incense, and/or any type of open flame within residential housing apartments, rooms, balconies, buildings and/or on grounds immediately adjacent to the on-campus housing is prohibited. Candles for any purpose (this includes but is not limited to decoration, religious rituals, etc.) are prohibited. If found, such items may be confiscated.
- **Heat Sources** - Open-coiled electric or heating appliances including, but not limited to space heaters and sun lamps within residential housing apartments, rooms, balconies, or buildings are prohibited. Curling Irons, glue guns, irons, or any other "heat source" equipment must be attended to all times. Leaving such equipment "on" and unattended is a violation of this policy.
- **Lamps and Lights** - Halogen lamps and neon lights are prohibited. Open top lamps, regardless of bulb type, need a metal screen fully covering light source. LED lights with an adhesive backing should not be affixed to walls or ceilings as they damage surfaces.
- **Plugs/Extension Cords** - Extensions cords, multi-plugs, and plug-in air fresheners are not permitted under state fire marshal regulations. Power strips/surge protectors with UL rating are permitted; connecting multiple power strips to each other is not permitted.
- **Cooking Equipment** - Cooking and/or Cooking Equipment such as toasters, stove-top grills, etc. are permitted ONLY in designated kitchen areas. Residents should pay close attention to all food being cooked. Cooking in residential hall rooms, apartment bedrooms, or balconies is prohibited. Residents interested in barbecuing should use the built-in gas barbeque in Coyote Village quad or electric grills. Barbecuing on balconies is prohibited.
- **Decorations** - All decorations must be non-combustible (e.g., made from fire-proof material) and be UL list-approved for intended use. Hanging flammable materials on ceilings or exterior areas or doors such as posters, flags, or nets is prohibited. Door decorations should not cover more than 20% of the surface and should be limited to nametags and memo boards. Fresh cut trees (i.e., Christmas trees) are prohibited. Decorations on doors should not damage or leave stains on the surface (see Care of Apartment & Rooms). Postings, signs, and decorations cannot be posted on or be visible through university housing windows or exteriors, including balconies.

Procedures students and employees should follow to report a fire:

- Determine the scope of the fire;
- Dial 911;
- Give the dispatcher the location of the fire as well as any circumstances. University Police Department will notify the Fire Department, and;
- Pull a fire alarm in the area.

Attempt to put out the fire with an extinguisher if it is safe to do so. Always evacuate the building when the fire alarm is activated and there is an immediate threat to safety.

Procedures for student housing evacuation (all student housing will adhere to the following procedure):

- Fire alarm goes off and/or is pulled
- Vacate the building immediately via the nearest stairwell and proceed at least 100 feet outside the building; specific evacuation locations provided in Resident Handbook
- Housing professional and para-professional staff knock on student doors as they evacuate the building
- Housing professional and para-professional staff report to the designated evacuation site and provide directions to evacuated students
- Await University Police to give an all-clear
- Housing professional staff will reset fire alarm (if false); and
- Housing professional or para-professional staff will submit an After-Action Report

A student's full cooperation in any evacuation is required. Failure to evacuate the building in the event of an alarm sounding will result in disciplinary action.

Policies for fire safety education and training programs for students, faculty, and staff:

- Resident Assistants hold semesterly hall meetings, part of these meetings include reminders about evacuation procedures;
- All Housing student staff receive training about fire drill/alarm protocols; and
- Simulation drills are conducted with DHRE professional and para-professional staff as per university policy.

Below is the list of the titles of each person or organization to which individuals should report that a fire has occurred:

- Vice President of Student Affairs, 909-537-5185
- Associate Vice President of Student Affairs/Dean of Students, 909-537-5185
- Director for Housing and Residential Education, 909-537-4155
- Chief of Police, 909-537-5165
- Associate Director of Residential Education, 909-537-3291
- Associate Director of Housing Facilities, 909-537-4155

Plans for future improvements in fire safety:

- Annual review of DHRE fire safety policies and procedures
- Regular inspections and tests of our fire suppression and protection systems; any deficiencies will be corrected in accordance with fire code

Fire Log Information

- A Fire Log is required by law under code 34 CFR 668.49(d) for universities with on-campus student housing. Fire safety policies and statistics are published annually in the fire safety report. Archived fire logs are saved for 3 years following publication of the last annual fire safety report.
- The Fire Log must record all reported fires, including Arson, in on-campus student housing facilities. The HEA requires the fire log to include the following information for each fire:
 - date the fire was reported;
 - the nature of the fire;
 - the date and time of the fire; and
 - the general location of the fire.
- The Fire Log is maintained by the University Police, and is available to public on the within the “Daily Crime/Fire Log Bulletin” for 60 days via the following link:
<https://csupd.crimegraphics.com/2013/default.aspx?InitialTab=14>
- Any portion of the log older than 60 days is available within two business days of a request for public inspection. Copies of the Fire Log may be obtained from UPD during business hours.

Commented [TB1]: Update with new link

Jeanne Clery Annual Safety Report

The 2025 Jeanne Clery Annual Safety Report for the CSUSB campus is available at the following link:

https://www.csusb.edu/sites/default/files/upload/file/2024/annual_security_report_2023.pdf

Commented [TB2]: Update with new link

Statistics and Related Information Regarding Fires in On-Campus Housing Facilities for 2020

| On-Campus Student Housing Facilities | Total Fires in Each Building | Fire Number | Cause of Fire | Number of Injuries That Required Treatment at a Medical Facility | Number of Deaths Related to Fire | Value of Property Damage Caused by Fire (in US dollars) |
|---|-------------------------------------|--------------------|----------------------|---|---|--|
| 6000 University Parkway - Arrowhead Village - Bldg. 2 | 0 | 0 | None | 0 | 0 | 0 |
| 6000 University Parkway - Arrowhead Village - Bldg. 3 | 0 | 0 | None | 0 | 0 | 0 |
| 6000 University Parkway - Arrowhead Village - Bldg. 4 | 0 | 0 | None | 0 | 0 | 0 |
| 6000 University Parkway - Arrowhead Village - Bldg. 5 | 0 | 0 | None | 0 | 0 | 0 |
| 6000 University Parkway - Arrowhead Village - Bldg. 6 | 0 | 0 | None | 0 | 0 | 0 |
| 6000 University Parkway - Badger Hall | 0 | 0 | None | 0 | 0 | 0 |
| 6000 University Parkway - Cajon | 0 | 0 | None | 0 | 0 | 0 |
| 6000 University Parkway - Coyote Village | 0 | 0 | None | 0 | 0 | 0 |
| 6000 University Parkway - Joshua Hall | 0 | 0 | None | 0 | 0 | 0 |
| 6000 University Parkway - Mojave Hall | 0 | 0 | None | 0 | 0 | 0 |
| 6000 University Parkway - Morongo Hall | 0 | 0 | None | 0 | 0 | 0 |
| 6000 University Parkway - Running Springs | 0 | 0 | None | 0 | 0 | 0 |
| 6000 University Parkway - San Manuel Hall | 0 | 0 | None | 0 | 0 | 0 |
| 6000 University Parkway - Serrano Village | 0 | 0 | None | 0 | 0 | 0 |
| 6000 University Parkway - Shandin Hall | 0 | 0 | None | 0 | 0 | 0 |
| 6000 University Parkway - Tokay Hall | 0 | 0 | None | 0 | 0 | 0 |
| 6000 University Parkway - Waterman Hall | 0 | 0 | None | 0 | 0 | 0 |
| 1577 Northpark Blvd - University Village - Bldg. 7 | 0 | 0 | None | 0 | 0 | 0 |
| 1577 Northpark Blvd - University Village - Bldg. 8 | 0 | 0 | None | 0 | 0 | 0 |
| 1577 Northpark Blvd - University Village - Bldg. 9 | 0 | 0 | None | 0 | 0 | 0 |

Source: Department of Housing and Residential Education

Statistics and Related Information Regarding Fires in On-Campus Housing Facilities for 2021

| On-Campus Student Housing Facilities | Total Fires in Each Building | Fire Number | Cause of Fire | Number of Injuries That Required Treatment at a Medical Facility | Number of Deaths Related to Fire | Value of Property Damage Caused by Fire (in US dollars) |
|---|-------------------------------------|--------------------|----------------------|---|---|--|
| 6000 University Parkway - Arrowhead Village - Bldg. 2 | 0 | 0 | None | 0 | 0 | 0 |
| 6000 University Parkway - Arrowhead Village - Bldg. 3 | 0 | 0 | None | 0 | 0 | 0 |
| 6000 University Parkway - Arrowhead Village - Bldg. 4 | 0 | 0 | None | 0 | 0 | 0 |
| 6000 University Parkway - Arrowhead Village - Bldg. 5 | 0 | 0 | None | 0 | 0 | 0 |
| 6000 University Parkway - Arrowhead Village - Bldg. 6 | 0 | 0 | None | 0 | 0 | 0 |
| 6000 University Parkway - Badger Hall | 0 | 0 | None | 0 | 0 | 0 |
| 6000 University Parkway - Cajon | 0 | 0 | None | 0 | 0 | 0 |
| 6000 University Parkway - Coyote Village | 0 | 0 | None | 0 | 0 | 0 |
| 6000 University Parkway - Joshua Hall | 0 | 0 | None | 0 | 0 | 0 |
| 6000 University Parkway - Mojave Hall | 0 | 0 | None | 0 | 0 | 0 |
| 6000 University Parkway - Morongo Hall | 0 | 0 | None | 0 | 0 | 0 |
| 6000 University Parkway - Running Springs | 0 | 0 | None | 0 | 0 | 0 |
| 6000 University Parkway - San Manuel Hall | 0 | 0 | None | 0 | 0 | 0 |
| 6000 University Parkway - Serrano Village | 0 | 0 | None | 0 | 0 | 0 |
| 6000 University Parkway - Shandin Hall | 0 | 0 | None | 0 | 0 | 0 |
| 6000 University Parkway - Tokay Hall | 0 | 0 | None | 0 | 0 | 0 |
| 6000 University Parkway - Waterman Hall | 0 | 0 | None | 0 | 0 | 0 |
| 1577 Northpark Blvd - University Village - Bldg. 7 | 0 | 0 | None | 0 | 0 | 0 |
| 1577 Northpark Blvd - University Village - Bldg. 8 | 0 | 0 | None | 0 | 0 | 0 |
| 1577 Northpark Blvd - University Village - Bldg. 9 | 0 | 0 | None | 0 | 0 | 0 |

Source: Department of Housing and Residential Education

Statistics and Related Information Regarding Fires in On-Campus Housing Facilities for 2022

| On-Campus Student Housing Facilities | Total Fires in Each Building | Fire Number | Cause of Fire | Number of Injuries That Required Treatment at a Medical Facility | Number of Deaths Related to Fire | Value of Property Damage Caused by Fire (in US dollars) |
|---|-------------------------------------|--------------------|----------------------|---|---|--|
| 6000 University Parkway - Arrowhead Village - Bldg. 2 | 0 | 0 | None | 0 | 0 | 0 |
| 6000 University Parkway - Arrowhead Village - Bldg. 3 | 0 | 0 | None | 0 | 0 | 0 |
| 6000 University Parkway - Arrowhead Village - Bldg. 4 | 0 | 0 | None | 0 | 0 | 0 |
| 6000 University Parkway - Arrowhead Village - Bldg. 5 | 0 | 0 | None | 0 | 0 | 0 |
| 6000 University Parkway - Arrowhead Village - Bldg. 6 | 0 | 0 | None | 0 | 0 | 0 |
| 6000 University Parkway - Badger Hall | 0 | 0 | None | 0 | 0 | 0 |
| 6000 University Parkway - Cajon | 0 | 0 | None | 0 | 0 | 0 |
| 6000 University Parkway - Coyote Village | 0 | 0 | None | 0 | 0 | 0 |
| 6000 University Parkway - Joshua Hall | 0 | 0 | None | 0 | 0 | 0 |
| 6000 University Parkway - Mojave Hall | 0 | 0 | None | 0 | 0 | 0 |
| 6000 University Parkway - Morongo Hall | 0 | 0 | None | 0 | 0 | 0 |
| 6000 University Parkway - Running Springs | 1 | 1 | Arson | 0 | 0 | ~\$1,800 |
| 6000 University Parkway - San Manuel Hall | 0 | 0 | None | 0 | 0 | 0 |
| 6000 University Parkway - Serrano Village | 0 | 0 | None | 0 | 0 | 0 |
| 6000 University Parkway - Shandin Hall | 0 | 0 | None | 0 | 0 | 0 |
| 6000 University Parkway - Tokay Hall | 0 | 0 | None | 0 | 0 | 0 |
| 6000 University Parkway - Waterman Hall | 0 | 0 | None | 0 | 0 | 0 |
| 1577 Northpark Blvd - University Village - Bldg. 7 | 0 | 0 | None | 0 | 0 | 0 |
| 1577 Northpark Blvd - University Village - Bldg. 8 | 0 | 0 | None | 0 | 0 | 0 |
| 1577 Northpark Blvd - University Village - Bldg. 9 | 0 | 0 | None | 0 | 0 | 0 |

Source: Department of Housing and Residential Education

Statistics and Related Information Regarding Fires in On-Campus Housing Facilities for 2023

| On-Campus Student Housing Facilities | Total Fires in Each Building | Fire Number | Cause of Fire | Number of Injuries That Required Treatment at a Medical Facility | Number of Deaths Related to Fire | Value of Property Damage Caused by Fire (in US dollars) |
|---|-------------------------------------|--------------------|----------------------|---|---|--|
| 6000 University Parkway - Arrowhead Village - Bldg. 2 | 0 | 0 | None | 0 | 0 | 0 |
| 6000 University Parkway - Arrowhead Village - Bldg. 3 | 0 | 0 | None | 0 | 0 | 0 |
| 6000 University Parkway - Arrowhead Village - Bldg. 4 | 0 | 0 | None | 0 | 0 | 0 |
| 6000 University Parkway - Arrowhead Village - Bldg. 5 | 0 | 0 | None | 0 | 0 | 0 |
| 6000 University Parkway - Arrowhead Village - Bldg. 6 | 0 | 0 | None | 0 | 0 | 0 |
| 6000 University Parkway - Badger Hall | 0 | 0 | None | 0 | 0 | 0 |
| 6000 University Parkway - Cajon | 0 | 0 | None | 0 | 0 | 0 |
| 6000 University Parkway - Coyote Village | 0 | 0 | None | 0 | 0 | 0 |
| 6000 University Parkway - Joshua Hall | 0 | 0 | None | 0 | 0 | 0 |
| 6000 University Parkway - Mojave Hall | 0 | 0 | None | 0 | 0 | 0 |
| 6000 University Parkway - Morongo Hall | 0 | 0 | None | 0 | 0 | 0 |
| 6000 University Parkway - Running Springs | 0 | 0 | None | 0 | 0 | 0 |
| 6000 University Parkway - San Manuel Hall | 0 | 0 | None | 0 | 0 | 0 |
| 6000 University Parkway - Serrano Village | 0 | 0 | None | 0 | 0 | 0 |
| 6000 University Parkway - Shandin Hall | 0 | 0 | None | 0 | 0 | 0 |
| 6000 University Parkway - Tokay Hall | 0 | 0 | None | 0 | 0 | 0 |
| 6000 University Parkway - Waterman Hall | 0 | 0 | None | 0 | 0 | 0 |
| 1577 Northpark Blvd - University Village - Bldg. 7 | 0 | 0 | None | 0 | 0 | 0 |
| 1577 Northpark Blvd - University Village - Bldg. 8 | 0 | 0 | None | 0 | 0 | 0 |
| 1577 Northpark Blvd - University Village - Bldg. 9 | 0 | 0 | None | 0 | 0 | 0 |

Source: Department of Housing and Residential Education

Statistics and Related Information Regarding Fires in On-Campus Housing Facilities for 2024

| On-Campus Student Housing Facilities | Total Fires in Each Building | Fire Number | Cause of Fire | Number of Injuries That Required Treatment at a Medical Facility | Number of Deaths Related to Fire | Value of Property Damage Caused by Fire (in US dollars) |
|---|-------------------------------------|--------------------|----------------------|---|---|--|
| 6000 University Parkway - Arrowhead Village - Bldg. 2 | 0 | 0 | None | 0 | 0 | 0 |
| 6000 University Parkway - Arrowhead Village - Bldg. 3 | 0 | 0 | None | 0 | 0 | 0 |
| 6000 University Parkway - Arrowhead Village - Bldg. 4 | 0 | 0 | None | 0 | 0 | 0 |
| 6000 University Parkway - Arrowhead Village - Bldg. 5 | 0 | 0 | None | 0 | 0 | 0 |
| 6000 University Parkway - Arrowhead Village - Bldg. 6 | 0 | 0 | None | 0 | 0 | 0 |
| 6000 University Parkway - Badger Hall | 0 | 0 | None | 0 | 0 | 0 |
| 6000 University Parkway - Cajon | 0 | 0 | None | 0 | 0 | 0 |
| 6000 University Parkway - Coyote Village | 0 | 0 | None | 0 | 0 | 0 |
| 6000 University Parkway - Joshua Hall | 0 | 0 | None | 0 | 0 | 0 |
| 6000 University Parkway - Mojave Hall | 0 | 0 | None | 0 | 0 | 0 |
| 6000 University Parkway - Morongo Hall | 0 | 0 | None | 0 | 0 | 0 |
| 6000 University Parkway - Running Springs | 0 | 0 | None | 0 | 0 | 0 |
| 6000 University Parkway - San Manuel Hall | 0 | 0 | None | 0 | 0 | 0 |
| 6000 University Parkway - Serrano Village | 0 | 0 | None | 0 | 0 | 0 |
| 6000 University Parkway - Shandin Hall | 0 | 0 | None | 0 | 0 | 0 |
| 6000 University Parkway - Tokay Hall | 0 | 0 | None | 0 | 0 | 0 |
| 6000 University Parkway - Waterman Hall | 0 | 0 | None | 0 | 0 | 0 |
| 1577 Northpark Blvd - University Village - Bldg. 7 | 0 | 0 | None | 0 | 0 | 0 |
| 1577 Northpark Blvd - University Village - Bldg. 8 | 0 | 0 | None | 0 | 0 | 0 |
| 1577 Northpark Blvd - University Village - Bldg. 9 | 0 | 0 | None | 0 | 0 | 0 |

Source: Department of Housing and Residential Education